
## **Physical installation instructions**

IKI electric heaters with UKU Glass Black control unit

Affixing the sensor to the ceiling: distance from heater frame 100–300 mm

The temperature sensor should be installed no less than 1000 mm from an undirected air vent income, or less than 500 mm from a directed air vent.



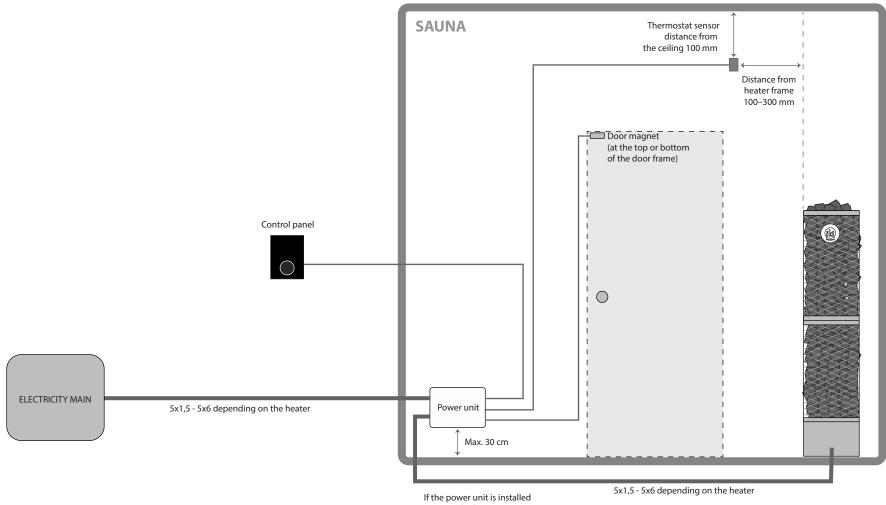

If the power unit is installed inside the sauna: Lower edge max. 30 cm from the floor Min. 100 cm from the heater Temperature max. 50°C Relative humidity max. 95%